


WTC 499.18  
M-3  
5/10/90

1. DRAWING NUMBER

1. DRAWING NUMBER

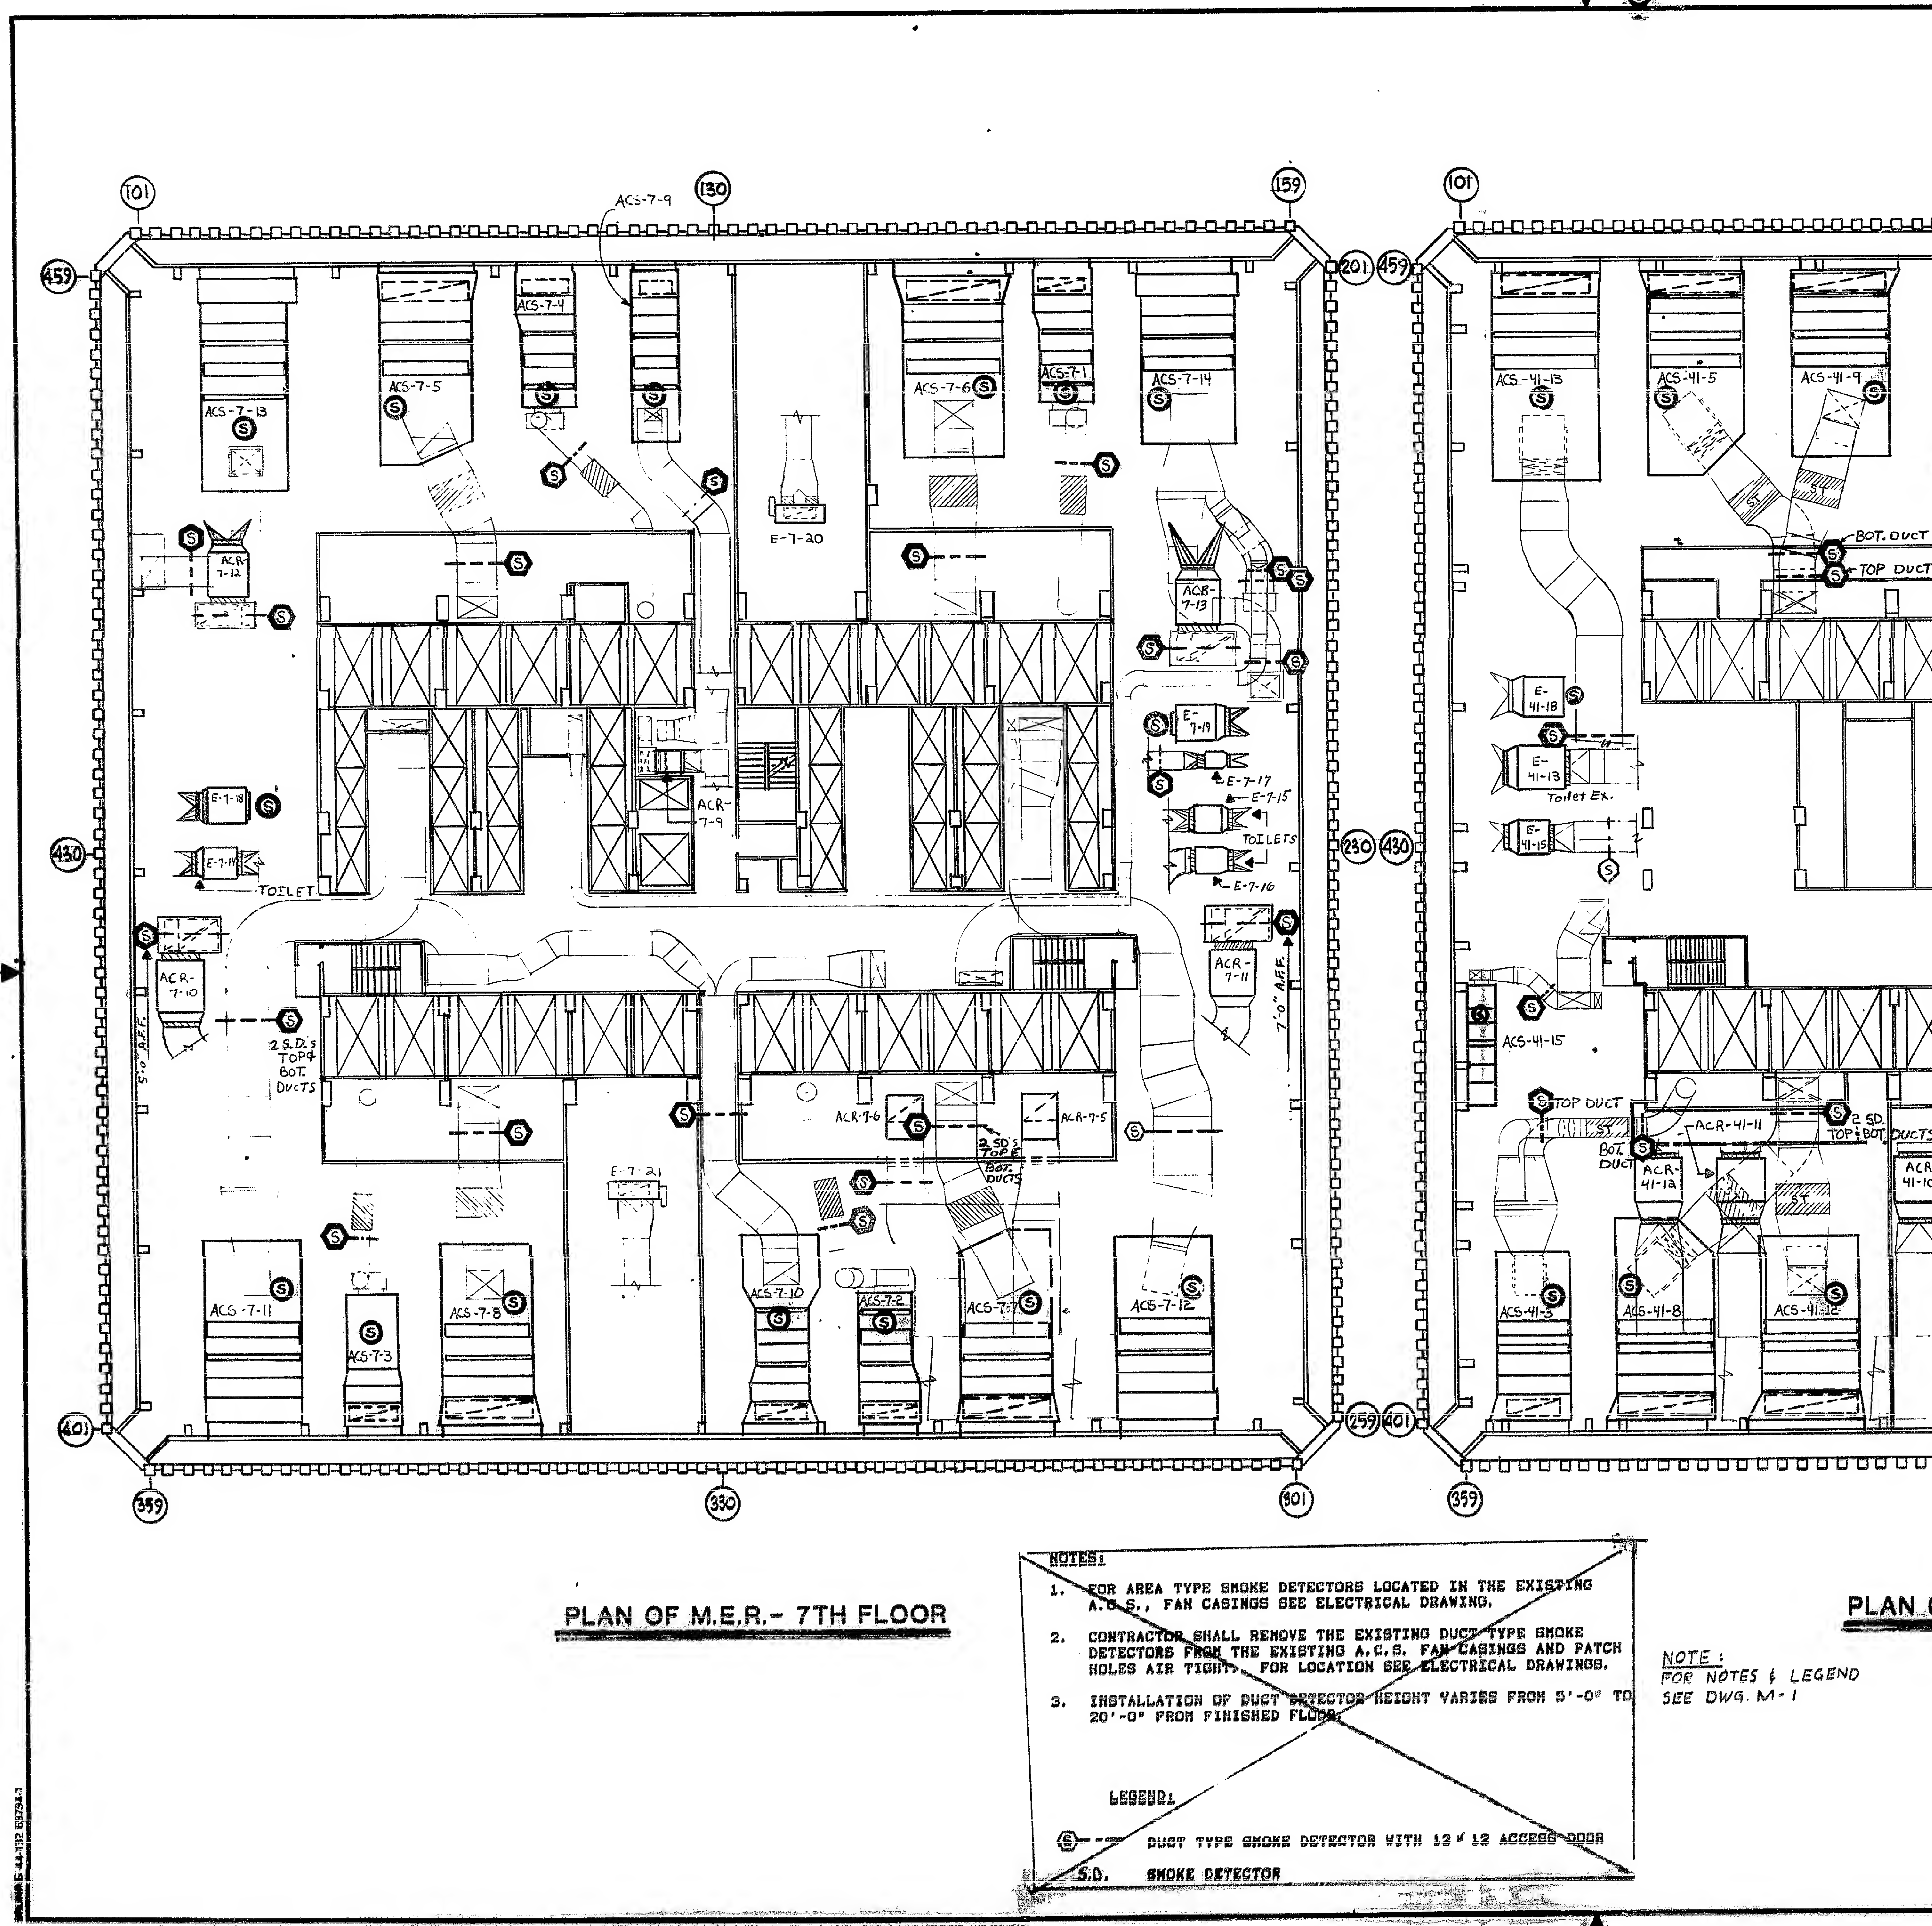

PLAN OF M.E.R.- 7TH FLOOR

**NOTES:**

1. FOR AREA TYPE SMOKE DETECTORS LOCATED IN THE EXISTING A.C.S., FAN CASINGS SEE ELECTRICAL DRAWING.
2. CONTRACTOR SHALL REMOVE THE EXISTING DUCT TYPE SMOKE DETECTORS FROM THE EXISTING A.C.S. FAN CASINGS AND PATCH HOLES AIR TIGHT. FOR LOCATION SEE ELECTRICAL DRAWINGS.
3. INSTALLATION OF DUCT DETECTOR HEIGHT VARIES FROM 5'-0" TO 20'-0" FROM FINISHED FLOOR.

**LEGEND:**

DUCT TYPE SMOKE DETECTOR WITH 12" x 12" ACCESS DOOR

S.D. SMOKE DETECTOR

NOTE:  
FOR NOTES & LEGEND  
SEE DWG. M-1

PLAN OF